


FIRE DETECTION AND ALARM SYSTEM

J-SAP-1341 Manual Fire Call Points

J-SAP-1341 Manual Fire Call Points Model: J-SAP-1341 Working voltage: DC8.5~32V
 Quiescent current: ≤0μA Alarm current: ≤70mA IP class: IP20 Hull material: ABS fire...

- ISO9001 Supplier
- Class Certificate
- Export Supply



Key Highlights


Category	Fire Detection and Alarm System
Standard	EN
Material	IP20 Hull material:
Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS

We can supply according to your requirement, drawings, class certificate needs, and delivery schedule.

Technical Specifications			
Category	Fire Detection and Alarm System	Model / SKU	J-SAP-1341-Manual-Fire-Call-Points
Standard	EN	Material	IP20 Hull material:
Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS	Warranty	12 Months unless specified otherwise
Origin	China		

China J-SAP-1341 Manual Fire Call Points:

J-SAP-1341 Manual Fire Call Points

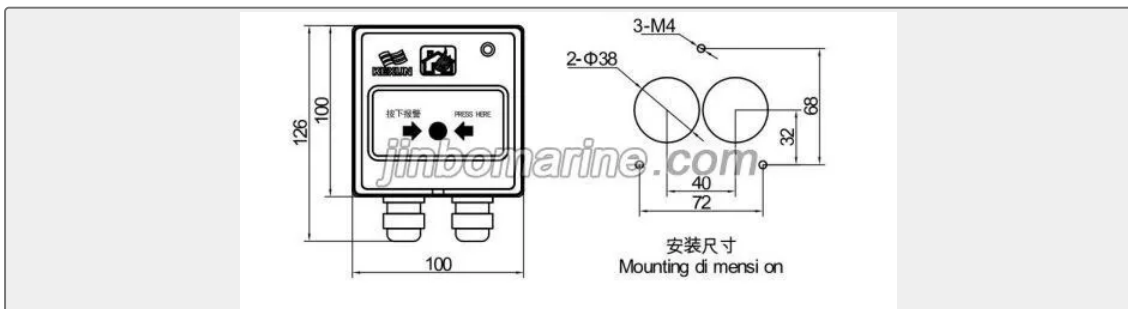

Model: J-SAP-1341

Working voltage: DC8.5~32V

Quiescent current: $\leq 0\mu\text{A}$

Alarm current: $\leq 70\text{mA}$

IP class: IP20

Hull material: ABS fire resistance

Colour: Red