

HOSPITAL CALLING ALARM SYSTEM

YJB-1Q YJB-1G Hospital Call Alarm Main Unit

ISO9001 Supplier

Class Certificate

Export Supply

YJB-1Q YJB-1G Hospital Call Alarm Main Unit 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society: 2)IMO resolution A.1021 (26) code on alerts and indicators,2009. ...



Key Highlights

Category	Hospital Calling Alarm System
Material	YJB-1Q YJB-1G Hospital Call Alarm Main Unit 1)Chapter 2 of Part 4 of the...
Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS

We can supply according to your requirement, drawings, class certificate needs, and delivery schedule.

Technical Specifications


Category	Hospital Calling Alarm System	Model / SKU	YJB-1Q-YJB-1G-Hospital-Call-Alarm-Main-Unit
Material	YJB-1Q YJB-1G Hospital Call Alarm Main Unit 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society:	Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS
Warranty	12 Months unless specified otherwise	Origin	China

China YJB-1Q YJB-1G Hospital Call Alarm Main Unit:

YJB-1Q YJB-1G Hospital Call Alarm Main Unit

- 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society:
- 2)IMO resolution A.1021 (26) code on alerts and indicators,2009.



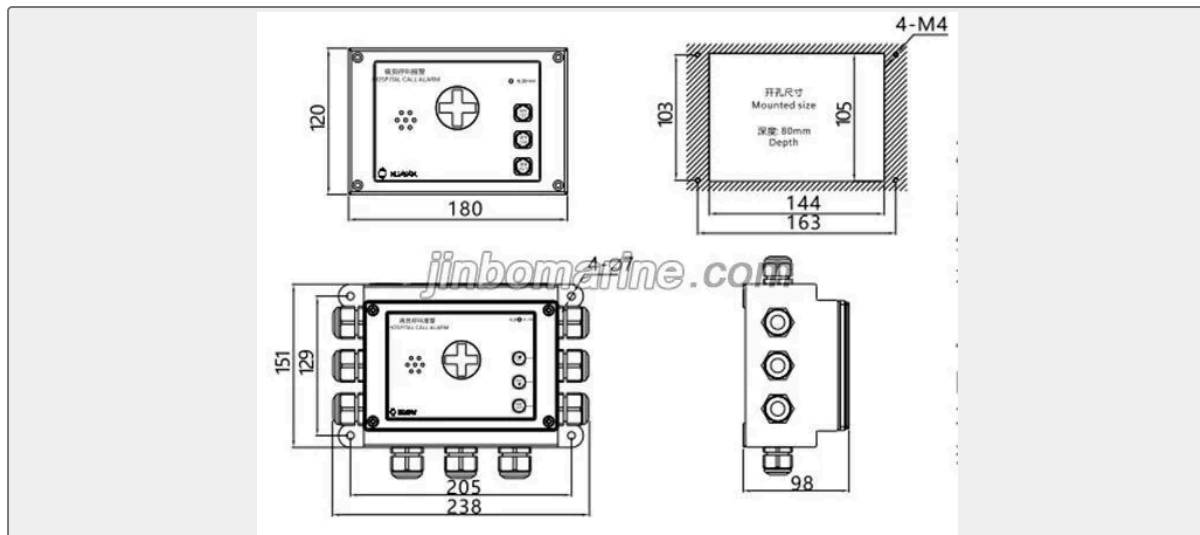

Colour: Dull black

Shell material: ABS

Cable gland: 6-PG16+3-PG21(wall mounted)

Power supply: DC24V±10%

IP rating: IP20/IP44

Power consumption: 50W

Alarm sound pressure level: 75dB~90dB