

HOSPITAL CALLING ALARM SYSTEM

YJB-1QF YJB-1GF Hospital Display Panel

ISO9001 Supplier

Class Certificate

Export Supply

YJB-1QF YJB-1GF Hospital Display Panel 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society: 2)IMO resolution A.1021 (26) code on alerts and indicators,2009. ...



Key Highlights

Category	Hospital Calling Alarm System
Material	YJB-1QF YJB-1GF Hospital Display Panel 1)Chapter 2 of Part 4 of the"Stee...
Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS

We can supply according to your requirement, drawings, class certificate needs, and delivery schedule.

Technical Specifications


Category	Hospital Calling Alarm System	Model / SKU	YJB-1QF-YJB-1GF-Hospital-Display-Panel
Material	YJB-1QF YJB-1GF Hospital Display Panel 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society:	Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS
Warranty	12 Months unless specified otherwise	Origin	China

China YJB-1QF YJB-1GF Hospital Display Panel:

YJB-1QF YJB-1GF Hospital Display Panel

- 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society:
- 2)IMO resolution A.1021 (26) code on alerts and indicators,2009.



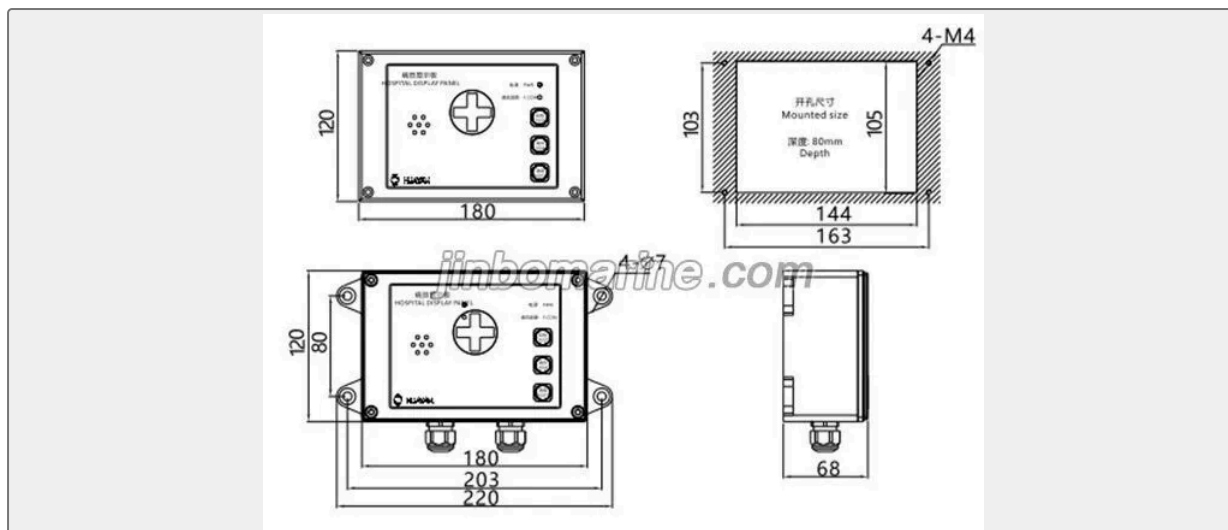

Colour: Dull black

Shell material: ABS

Cable gland: 2-PG16(wall mounted)

Alarm sound pressure level: 75dB~90dB

IP rating: IP20/IP44