

Jinbo Marine

Marine & Offshore Equipment Datasheet

PRODUCT DATASHEET

HOSPITAL CALLING ALARM SYSTEM

YJB-HJ-G Wall Mounted Hospital Call Point

ISO9001 Supplier

Class Certificate

Export Supply

YJB-HJ-G Wall Mounted Hospital Call Point 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society: 2)IMO resolution A.1021 (26) code on alerts and indicators,2009. ...



Key Highlights

Category	Hospital Calling Alarm System
Material	YJB-HJ-G Wall Mounted Hospital Call Point 1)Chapter 2 of Part 4 of the"S...
Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS

We can supply according to your requirement, drawings, class certificate needs, and delivery schedule.

Technical Specifications


Category	Hospital Calling Alarm System	Model / SKU	YJB-HJ-G-Wall-Mounted-Hospital-Call-Point
Material	YJB-HJ-G Wall Mounted Hospital Call Point 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society:	Certificate	ABS, LR, BV, DNVGL, NK, KR, IRS, RMRS, CCS
Warranty	12 Months unless specified otherwise	Origin	China

China YJB-HJ-G Wall Mounted Hospital Call Point:

YJB-HJ-G Wall Mounted Hospital Call Point

- 1)Chapter 2 of Part 4 of the"Steel Ship Classification Rules" of the China Classification Society:
- 2)IMO resolution A.1021 (26) code on alerts and indicators,2009.



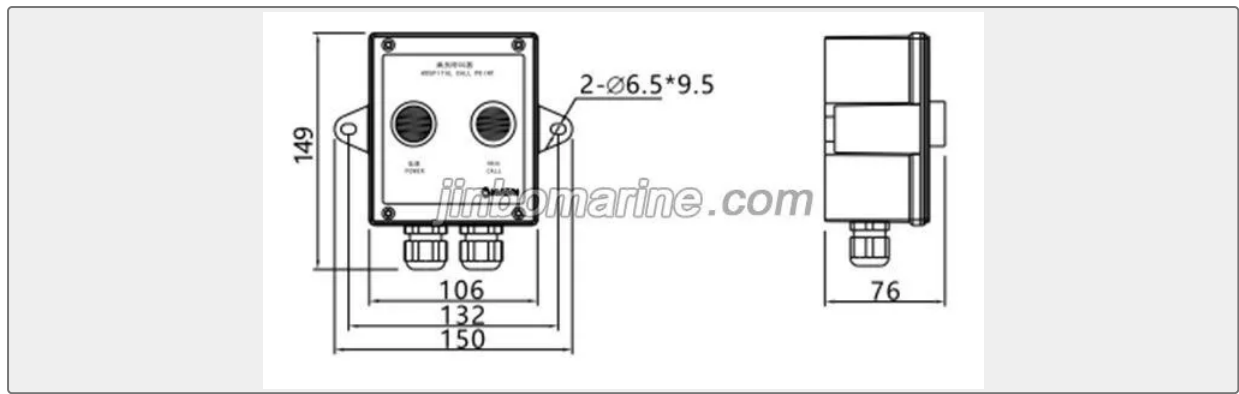

Colour: Magnetic White

Shell material: ABS

Cable gland: 2-PG16

IP rating: IP56